

ADAPTIVE POWER SYSTEM STABILIZER OF THE COMBINED CYCLE POWER STATION USING NEURAL NETWORK

JOSE A. DO NASCIMENTO¹, EDWARD L. F. DANIEL¹, FRANCIS MARY F. DE SOUZA¹, JOSE N. R. DA SILVA JR¹, JOSE C. T. CAMPOS¹, LUIZ H. S. C. BARRETO¹, MARCELO FALCUCCI²

1. *Electrical Engineering Department, Federal University of Ceará*
ZIP 60455-760, Postal Code 6001, , Fortaleza, Ceará, Brazil
E-mails: almeida@dee.ufc.br, edwardlennon@gmail.com,
nilorodrigues@coelce.com.br, teles@dee.ufc.br, lbarreto@dee.ufc.br

2. *Fortaleza Thermolectric Central Generation (CGTF-ENDESA)*
ZIP 61600-000, Postal Code 117, Caucaia, Ceará, Brazil.
E-mails: mfalcucci@endesabr.com.br

Abstract— This paper presents a parameter modeling to Adaptive Power System Stabilizers using multi layer perceptron and radial basis function neural networks architecture. The application of neural networks in power system stabilizers aims to improve the dynamic stability of electric power systems by reducing the machine eletromechanic damping oscillation when a disturbance occurs. According to the current plant operating conditions, the PSS parameters are automatically adjusted by the neural network in sense to give a satisfactory control. The observed performance for the proposed approach is tested in simulations, using a nonlinear dynamic model of infinite bus machine type. The results show that it is possible to improve the power system dynamic performance with the new modeling.

Keywords— Power system, combined cycle plants, dynamic stability, neural network

1 Introduction

The power plants use synchronous generators whose electromechanical oscillations of low frequency, when badly damped, they are harmful to the electrical system, because that they can cause the loss of synchronism of the generators. The use of Power System Stabilizers (PSS) for the improvement of the dynamic stability of the power systems has received bigger attention in the last years [1].

The adjustments of the parameters used in these controllers are determined through a linear model of the system around a nominal operation point. However, the performance of the conventional PSS degrades when a change in its operation point occurs [2].

Some techniques such as adapted control have been proposals as solution of the problem [5], [6]. However, the most of adapted controls is based on parameters identification on the system model in real time, but it consumes much time. Robust control techniques, fuzzy logic and PSS design based on Lyapunov also are other alternatives to treat the problem [7], [8], [9] [10], [11], [12],[13]. However, their responses are slow and real time applications are limited.

In this paper two modeling forms for PSS's parameters using neural networks are proposals: Multilayer Perceptron (MLP) and Radial Basis Function (RBF). The use of a neural network for parameters adjustment becomes possible the practical implementation of the method and the parameters adequacy for different operation points. The neural network advantage it is in the diverse of operations

points since it operates with inexact data and not total defined situations.

2 System's Description

In the Brazilian Interconnected System, the demand for energy generation next to the consumption place comes growing stimulated by the public and governmental pressure for the energy matrix diversification, currently centered in the hydraulic generation. The incentive for new electric energy generation sources contributed to increase the use of the natural gas. The thermolectric plants are benefit by the combined cycle technology that better use the natural gas advantage and consequently to increase the income of them.

A combined cycle thermolectric plant has associates to the same plant gas turbines and steam turbine generating electric energy. The thermolectric in study possess an installed power of 310,7MW, being composed for: (i) two gas turbines, each one with nominal power of 112,8MW, (ii) one steam turbine with nominal power of 113,1MW, (iii) two boilers of heat recovery, (IV) two generators of 133,8MVA and (v) a generator with nominal power of 147MVA.

The process is initiated with atmospheric air being sucked for the combustion turbines compressors. Air is tablet, mixed with the natural gas, and after that this mixture is burnt. This process originates gases with high temperatures and pressures that are sent for the responsible turbine for converting the thermal energy into mechanics. The connected electric generator to the turbine's axle

x'_d = direct axle transitory reactance.
 x_q = quadrature axle reactance.
 x'_q = quadrature axle transitory reactance.
 x_e = circuit's proper reactance of the rotor's iron.
 γ = admittance angle series equivalent less the torque angle.
 I_{q0} = current component in the quadrature axle.
 V_{q0} = terminal voltage's component of the generator in the quadrature axle in the machine's reference.
 V_{d0} = terminal voltage's component of the generator in the direct axle at machine's reference.
 V_{t0} = generator's terminal voltage in permanent regimen (absolute value).

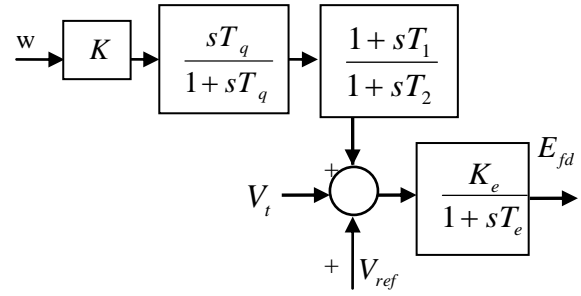


Figure 3: PSS's blocks Diagram.

Table 1 represents the data that will be used as base for neural network's training. The inputs mention the active power (P) and reactive power (Q) and the outputs are the PSS's parameters. The attainment of these data was gave through the stabilizer's conventional model, as shown in Figure 3.

Table 1: Data of entrance of the neural nets

Inputs		Outputs	
P	Q	T ₁	T ₂
10	-17.5	1.2290	0.0132
20	-18.2	1.1354	0.0139
30	-18.8	1.0980	0.0148
40	-19.2	0.6139	0.0264
50	-19.6	0.4691	0.0346
60	-19.8	0.3834	0.0425
70	-20	0.3398	0.0478
80	-20	0.3063	0.0530
90	-19.9	0.2861	0.0567
100	-19.7	0.2686	0.0604

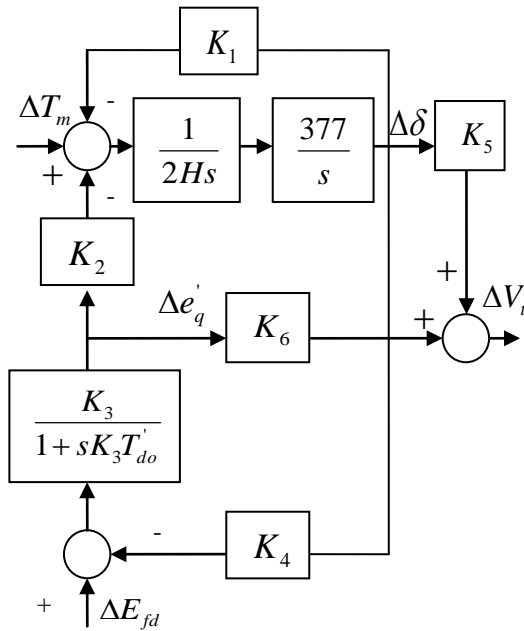


Figure 2: Machine infinite bus blocks diagram.

4 Power System Stabilizer

A Power Systems Stabilizer (PSS) is an element, or group of elements, that supplies an additional input to the regulator to improve the power systems dynamic performance. The main function of the conditional signal to the PSS's net is to compensate the system's delay to be controlled [9].

The phase compensation is realized through by the use of functions lead-lag that supplies phase advance on the scale of interest frequency. The diagram of Figure 3 represents the stabilizer. The first block represents gain K, the second block is a filter washout to eliminate errors in the input signal, and the third block is a circuit lead-lag with time constants T1 and T2.

5 Modeling by Neural Networks

Two algorithms had been implemented, Neural Network RBF, that is composed for an hidden layer and a output layer, and the Neural Net MLP, that possess two hidden layers.

The disadvantage of use a stabilizer's conventional model are in the fact of the parameters adjustment to be limited to only one operation point, with just established frequency, what it can become an inefficient damping out of this point.

The RBF implementation is composed for a hidden and output layer. Differently of the MLP, where each neuron defines a separation plan [3], the RBF defines one circle in the input space through a Gaussian function.

Another difference between these nets is the fact of the MLP to use internal products, while the RBF uses distances. In the developed net, with each input data has been associated a specific center. In hidden neuron activation it is determined by a nonlinear function of the distance between the input vector and a reference vector.

The RBF has a simple architecture, consisting two layers of weights (WE and WS), where the first one contains the radial bases functions parameters and the second form linear combinations of the function's radial base activations to generate the output [4].

It is trained in two periods, with the functions of radial base being determined first for not-supervised techniques, using for input data and the second layer (weights), being later determined for supervised linear methods (linear function), of fast convergence.

The analyzed neural networks are composed for the inputs and outputs in accordance with Table 1. The neural network parameter adjustment is shown in Figure 4.

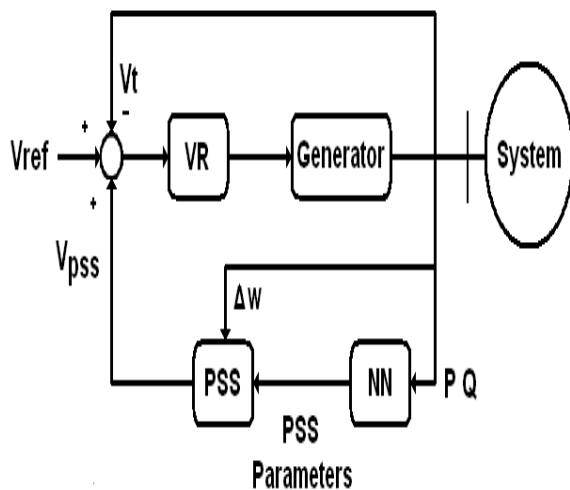


Figure 4: System's blocks diagram with neural network's inclusion.

The of neural network's interpolation capacity is a useful characteristic to the treated problem, once that the table use to store the parameters values T1 and T2 in different points operation would be extensive due to infinity of points situated between two points.

This neural networks ability has become them useful for the modeling of nonlinear systems. Since the set of operations points found in Table 1 is nonlinear.

The neural networks most significant characteristic is the ability to approach any continues nonlinear function of a desired correction degree.

6 Results and Discussion

The machine's mathematical model and the controllers was incorporated to the program Transitory Analysis Electromechanical (ANATEM), in which simulations had been carried through that had served for the database composition used in the training and neural networks validation .

Neural networks MLP and RBF had been projected for convergence with maximum error of 0.00001. The MLP presented convergence in 10 iterations and the RBF in 8 iterations. The data gotten for the nets are in Table 2.

Table 2: Neural network's validation data

INPUT		OUTPUT MLP		OUTPUT RBF	
P	Q	T ₁	T ₂	T ₁	T ₂
55	-19.7	0.4250	0.0377	0.4142	0.0400
95	-19.8	0.2790	0.0579	0.2761	0.0588
110	-19.4	0.2515	0.0584	0.2671	0.0607

It was applied a step of 2% in the load and simulated the system in three situations was applied Figure 5: (i) without the stabilizer, (ii) using the stabilizer adjusted in field and (iii) using the stabilizer with projected parameters.

As it can be verified by the curves, the system without the stabilizer is very oscillatory, what it can take the loss of machine's synchronism. With the PSS it can be observed the advantage in to use the parameters adjustment using neural networks for the biggest damping, in detriment of the parameters gotten through the conventional model.

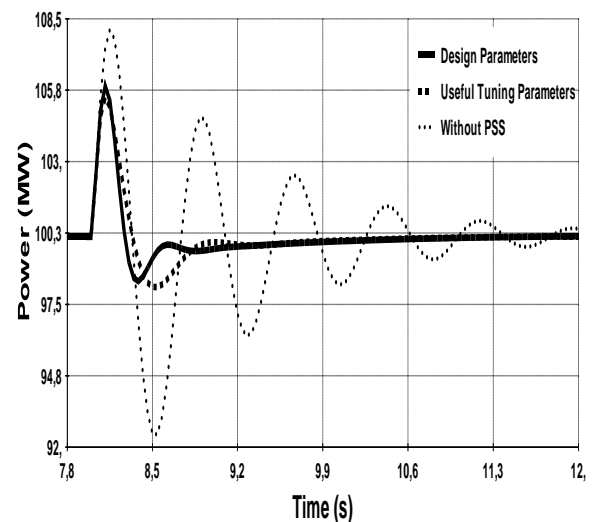


Figure 5: Comparison between field values and calculated for 100% of load.

Figures 6 and 7 show the tuning influence for two operation points. As the calculated fixed parameter for nominal power it moves away from the same one, the parameters tuning for the neural networks becomes more important.

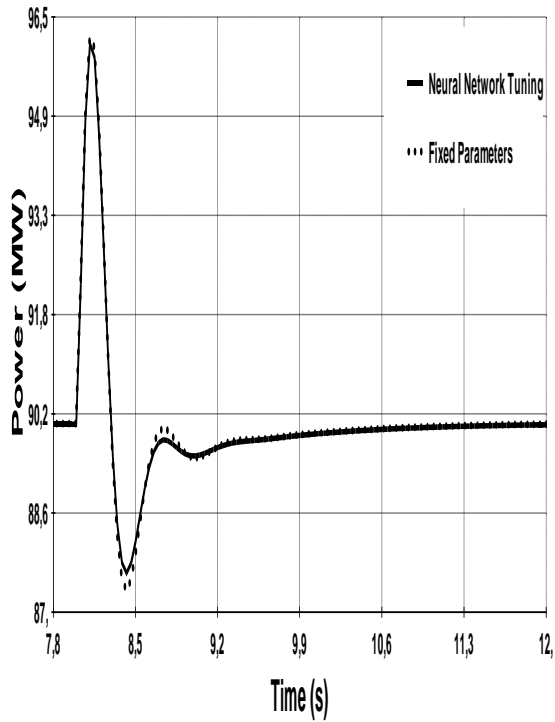


Figure 6: Comparison between neural network tuning and calculated fixed parameters for 100% of load applied in 90%.

Figures 8, 9 and 10 use the tuning of Table 2 in the MLP and RBF validation propose, because the points are out of the set of training and show the capacity of the nets in interpolating and surpassing given.

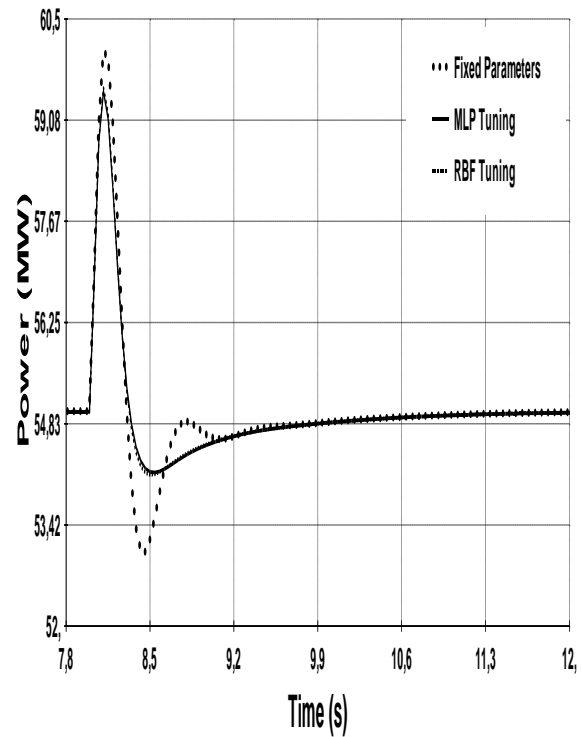


Figure 8: Comparison between MLP and RBF tuning and calculated fixed parameters for 100% of load applied in 55%.

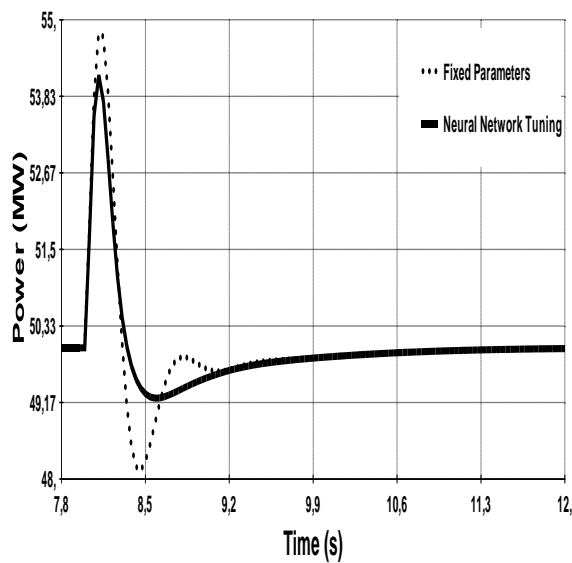


Figure 7: Comparison between neural network tuning and calculated fixed parameters for 100% of load applied in 50%.

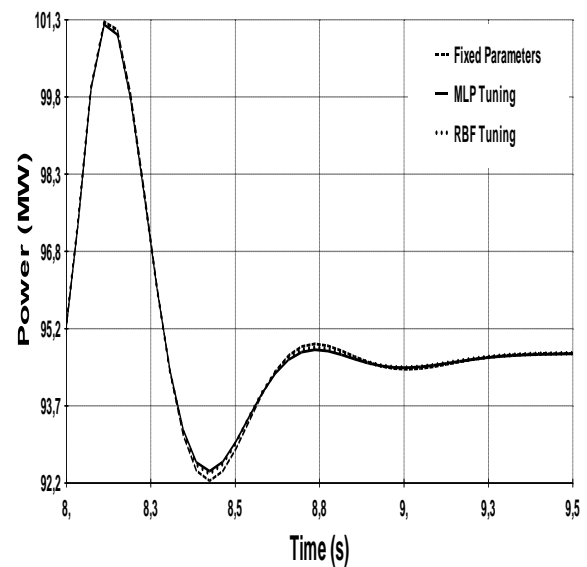


Figure 9: Comparison between neural networks tuning MLP and RBF and calculated fixed parameters for 100% of load applied in 95%.

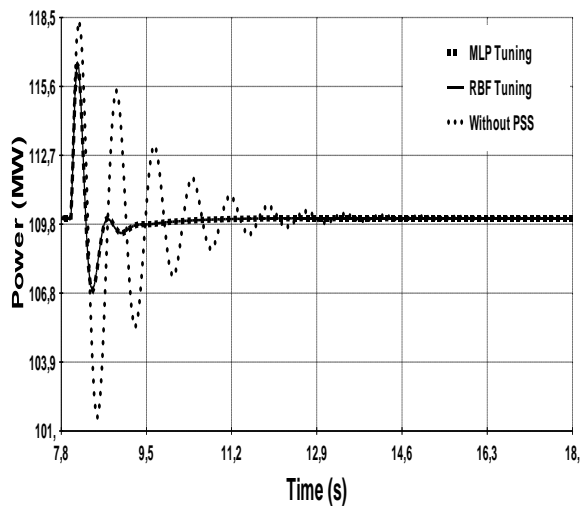


Figure 10: Comparison between MLP and RBF tuning and system without ESP applied in 110%.

7 Conclusion

The solutions had presented satisfactory resulted. However, the carried through tests had shown that the RBF application converged more quickly than the carried through with the MLP.

The Gaussians tuning centers to each input of the set training became the system convergence fastest. With only 8 iterations for the adjustments the attainment of a sufficiently necessary approach was possible.

The main advantage observed with the use of neural networks in the parameters' modeling of the PSS was the capable controllers' attainment of automatically adapt the different operation points, what it developed the oscillations' damping.

The simulations had proven that the damping of the adjusted machine for fixed parameters it spoils as soon as operation condition moves away from the established operation point.

In comparison, the neural networks had presented good data extrapolation, therefore excellent values for the parameters had been found when a load of 110% to the system was applied.

Acknowledgment

The authors thank the Fortaleza Thermoelectric Power plant - CGTF, company of the ENDESA group, to the National Advice Scientific and Technological Development – CNPq, the Superior Level Perfection Coordination Staff - CAPES and the Research Support Foundation – FUNCAP for the support technician and financing the research.

References

- [1] P. M. Anderson and A. A. Fouad, (1994) Power System Control and Stability, IEEE, New York.
- [2] P. Kundur, (1994) Power System Stability and Control, McGraw-Hill, New York.
- [3] A. M. Sharaf, T. T. Lie and H. B. Gooi, (1993) Neural Network Based Power System Stabilizers, IEEE Trans. PWRS, pp. 8186-4260.
- [4] M. A. Abido and Y. L. Abdel-Magid, (1997) Radial Basis Function Network Based Power System Stabilizers for Multimachine Power Systems, IEEE Trans PWRS, pp. 7803-4122.
- [5] A. Ghandra, O. P. Malik and G.S. Hope, (1988) A self-tuning controller for the control of multi-machine power systems, IEEE Trans. PWRS, vol. 3, no. 3, pp. 1065-1071.
- [6] D. Xia and G. T. Heydt, (1983) Self-tuning controller for generator excitation control, IEEE Trans. PAS, vol. 102, pp. 1877-1885.
- [7] A. Swarczewicz and K. Wróblewska-Swarzewicz, (2001) Robust Power System Stabilizer, IEEE Porto Power Tech Conference, pp. 7803-7139, Porto.
- [8] N. S. D. Arrifano, V. A. Oliveira and R. A. Ramos, (2004) Design and Application of Fuzzy PSS for Power Systems Subject to Random Abrupt Variations of the Load, American Control Conference, Vol II, pp. 1085-1090, Boston.
- [9] Mishra, S. (2006) Neural-network-based adaptive UPFC for improving transient stability performance of power system. IEEE Transactions on Neural Networks, Volume:17, Issue: 2
- [10] Chaturvedi, D.K.; Malik, O.P. (2008) Neurofuzzy Power System Stabilizer., IEEE Transactions on Energy Conversion Volume:23, Issue: 3
- [11] Ray S., Venayagamoorthy G., (2009). A wide area measurement based neurocontrol for generation excitation systems. Eng. Appl. Artif. Intell., 22 No. 3, 473-481.
- [12] Nare, R.; Panda, P.C.; Therattil, J.P. (2012) Damping of inter-area oscillations in power system using genetic optimization based coordinated PSS with FACTS stabilizers. India Conference (INDICON), Annual IEEE
- [13] A. Chatterjee, S.P. Ghoshal, V. Mukherjee (2012) Transient performance improvement of grid connected hydro system using distributed generation and capacitive energy storage unit. International Journal of Electrical Power & Energy Systems. Volume 43, Issue 1, Pages 210–221